



## Smoke Detectors and Carbon Monoxide

Following is a listing of the general requirements for the installation of smoke alarms and carbon monoxide alarms for residential buildings based on the 2022 California Building Code (CBC), 2022 California Electrical Code (CEC), 2022 California Residential Code (CRC), and the 2022 California Fire Code (CFC). This information bulletin is intended to provide general information, contact the Building Safety Division for any questions or additional information.

### **New Construction and Additions**

In new construction and additions, required smoke alarms and carbon monoxide alarms shall receive their primary power from the permanent building electrical power system (and shall be on the lighting circuit connected within the same room as the smoke alarm). Where two or more smoke alarms or carbon monoxide alarms are required they shall be interconnected in such a manner that actuation of one shall cause actuation of all detectors in the dwelling unit (CBC 907.2.11, CRC R314, CRC R315).


All new electrical outlets (including smoke alarms, carbon monoxide alarms, receptacles, switches, lighting, etc.) shall be on circuits protected with a combination arc-fault circuit interrupter (CEC 210.12)

### **Remodeled Dwelling Units**

When a permit is required for any repair, alterations, or addition smoke alarms and carbon monoxide alarms shall be installed in accordance with the following location and maintenance provisions. In existing dwelling units, smoke alarms and carbon monoxide may be battery operated (CBC 907.2.11, CRC 314, CRC 315).

### **Smoke Detectors and Carbon Monoxide Alarms Shall Be Installed**

*Smoke alarms and carbon monoxide alarms are required to be listed by the California State Fire Marshal.*

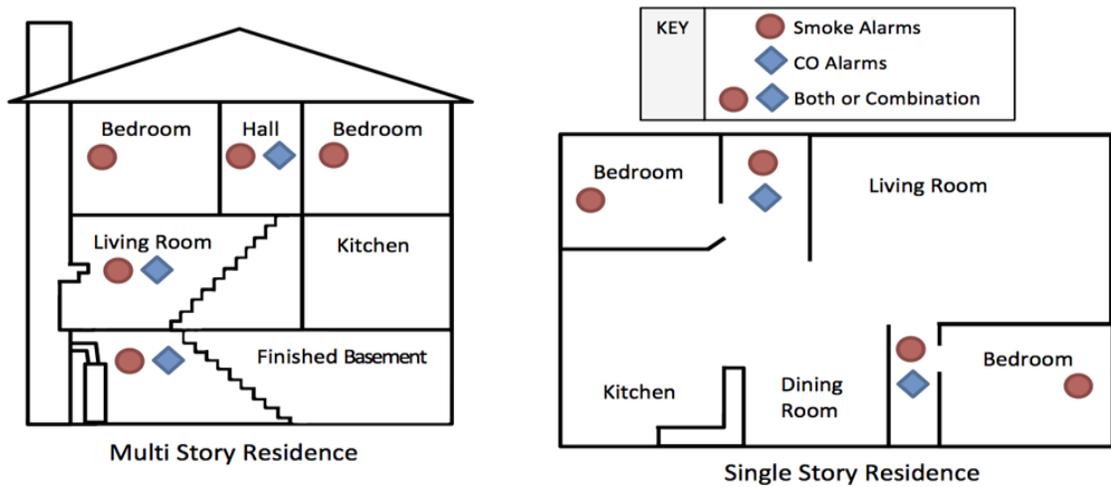

Required Areas for Project Exceeding	Smoke Detectors [CRC 314, CBC 907.2]	CO Alarms* [CRC 315, CBC 907.2]
In each sleeping room	Yes	
Outside of each sleeping room	Yes	Yes
On every level including basements	Yes	Yes
In enclosed common stairwells of apartment complexes and other multiple-dwelling complexes	Yes	
In a group R-3.1 (i.e., adult residential facilities), in addition to the above, smoke alarms shall be provided throughout the habitable areas of the dwelling unit except kitchens	Yes	Yes

\*CO alarm not required if there are no fuel burning appliances and no attached garages.

**Smoke Alarm and Carbon Monoxide Alarm Device Location**

Smoke alarms shall be installed on the ceiling or wall between 4” and 12” of the ceiling. Carbon monoxide alarms shall be installed on the ceiling or wall above the door header.

**Maintenance**

The owner shall be responsible for testing and maintaining detectors in hotels, motels, lodging houses, and common stairwells of apartment complexes and other multiple dwelling complexes. The smoke alarm shall be operable at the time that the tenant takes possession. The apartment complex tenant shall be responsible for notifying the manager or owner if the tenant becomes aware of an inoperable smoke alarm within his or her unit. The owner or authorized agent shall correct any reported deficiencies in the smoke alarm and shall not be in violation of this section for a deficient smoke alarm when he or she has not received notice of the deficiency (CFC 907.9 and California Health and Safety Code 13113.7).

**Smoke Alarm and Carbon Monoxide Alarm Device Location**

Smoke alarms shall be installed on the ceiling or wall between 4” and 12” of the ceiling. Carbon monoxide alarms shall be installed or manufacture recommendations requirement.

**Smoke Alarm Batteries and Replacement**

All newly installed smoke alarms shall have a 10-year battery. Smoke alarms shall be replaced 10 years from the date of manufacture marked on the unit (CBC 907.2.11.2, CRC 314, CRC 315).

**CERTIFICATION**

I understand the above requirements and certify that I now have smoke alarms and carbon monoxide alarms installed as required above.

**Address:** \_\_\_\_\_ **Permit #** \_\_\_\_\_

**Homeowner’s Name(s) :** \_\_\_\_\_  
(Please print):

**Signature:** \_\_\_\_\_ **Date:** \_\_\_\_\_